

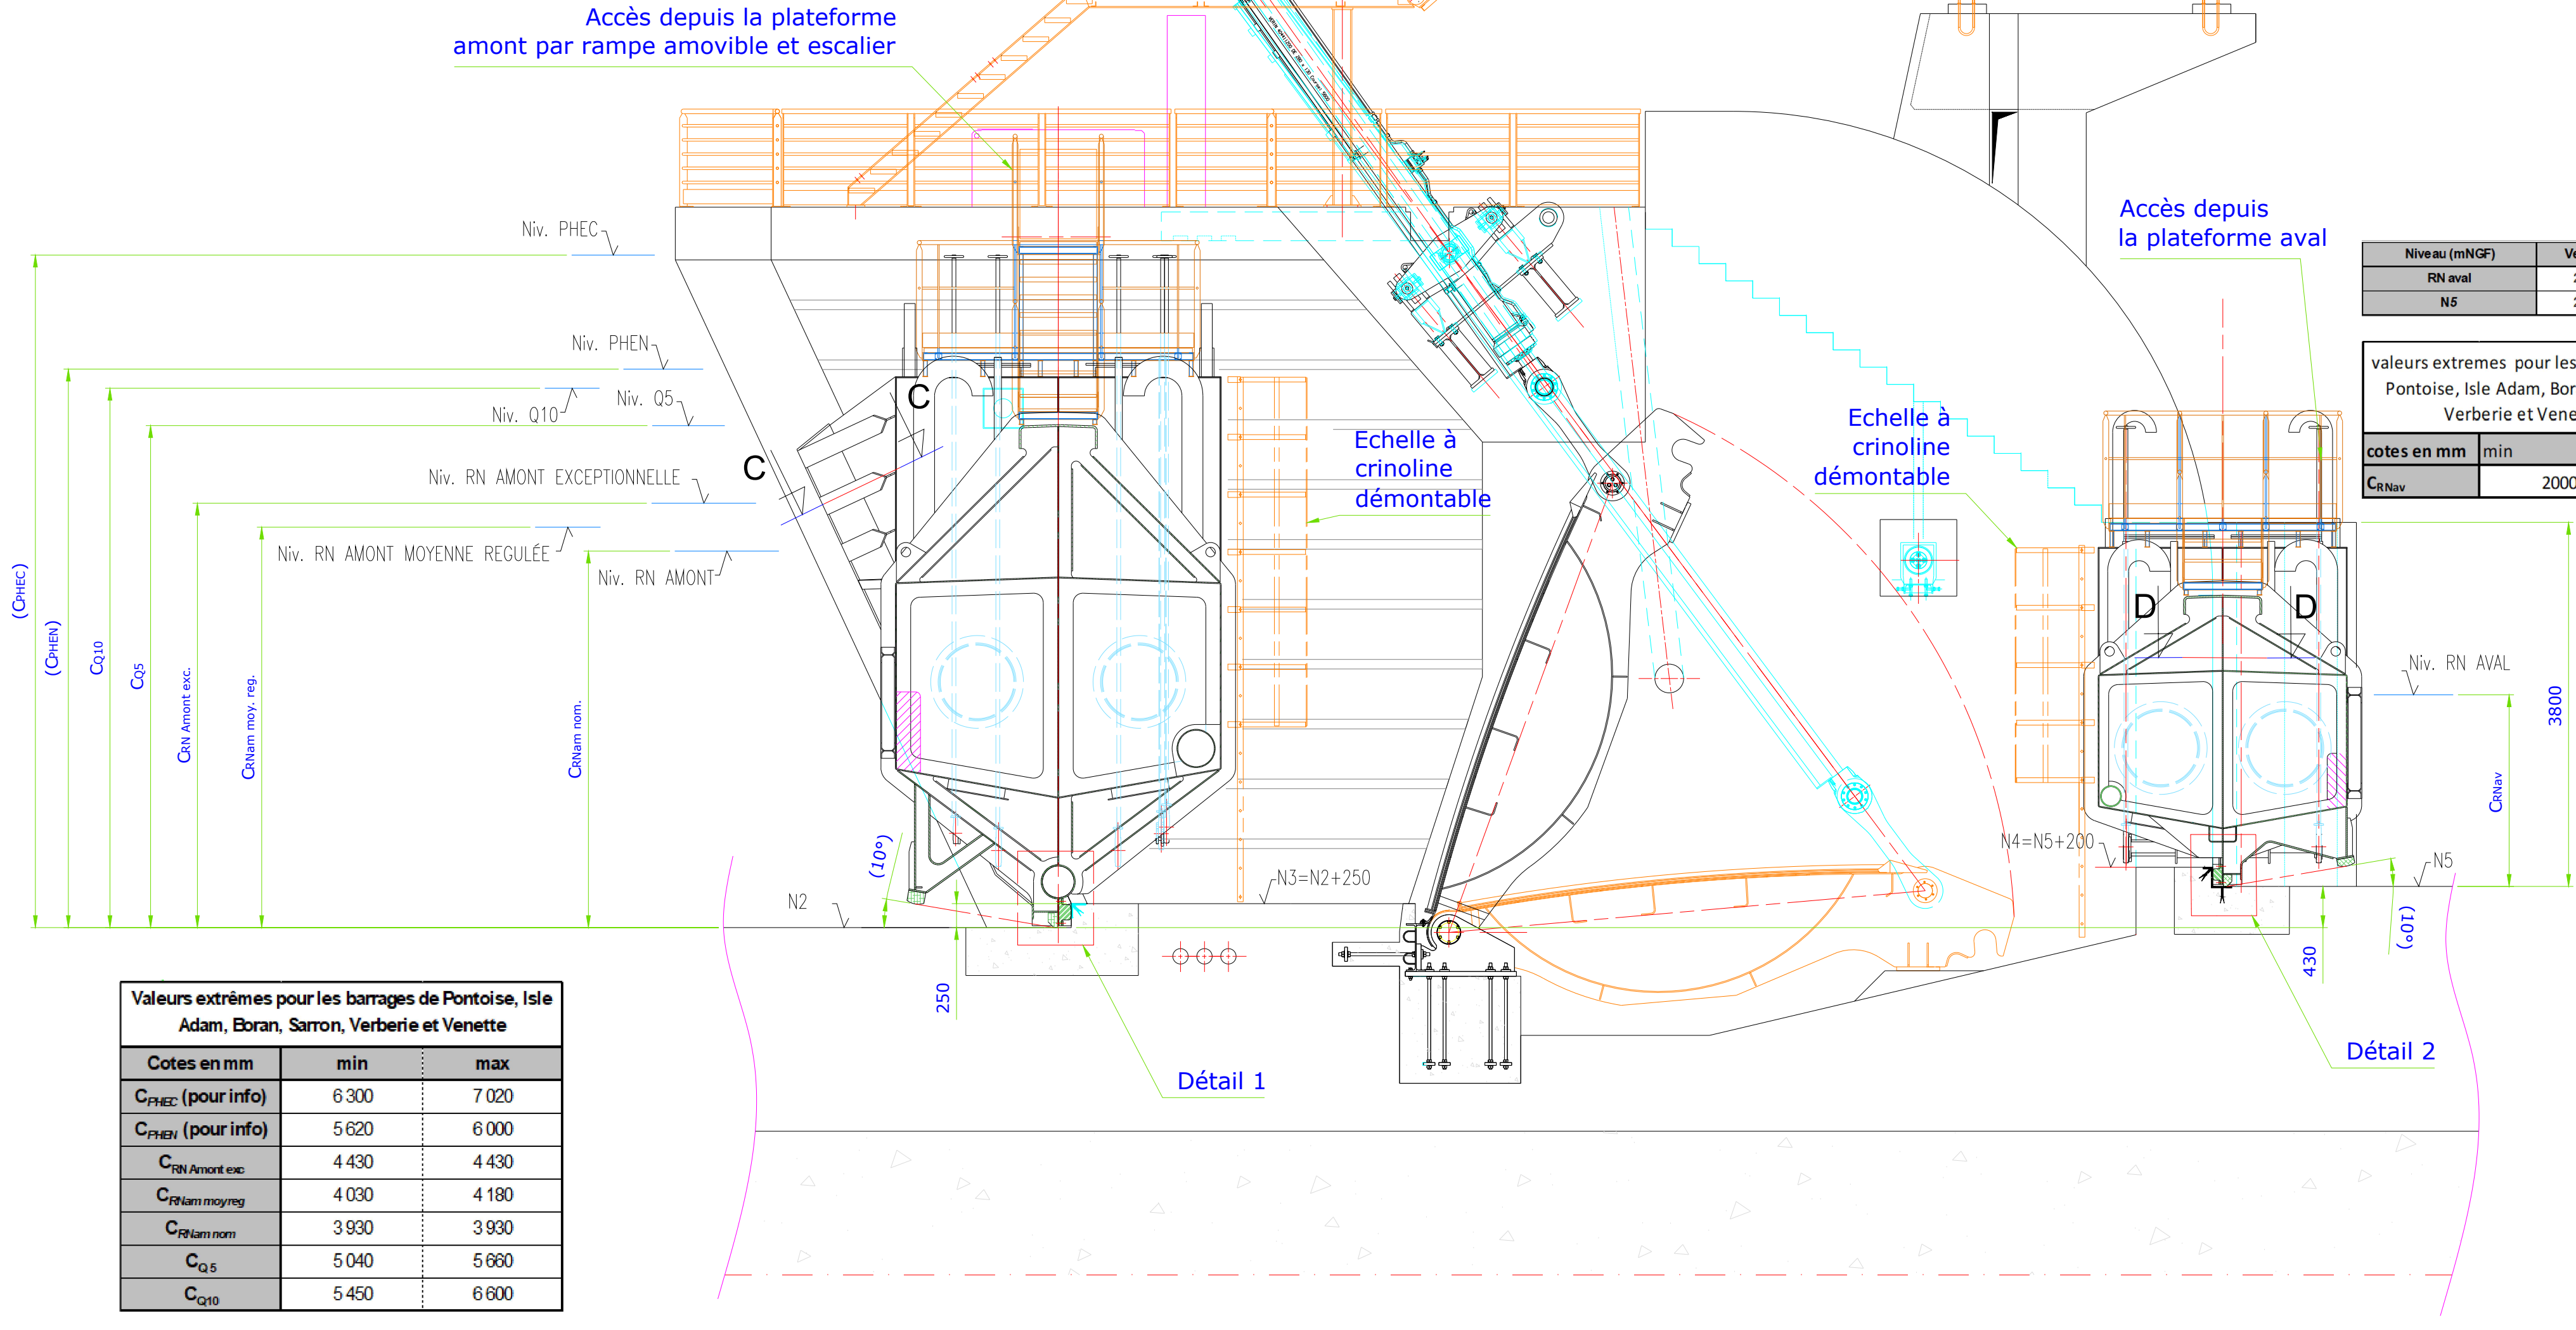


Niveau (mNGF)	Venette	Verberie	Sarron	Boran	Isle Adam	Pontoise
PH2C (pour info)	33,71	32,24	31,05	27,49	26,56	25,02
PH2N (pour info)	32,7	31,54	30,25	26,88	25,43	23,83
RN amont exceptionnelle	31,51	30,08	28,69	25,62	24,02	22,43
RN amont moyenne régulée	31,16	29,7	28,35	25,22	23,72	22,18
RN amont nominale	31,01	29,58	28,19	25,12	23,52	21,93
N2	27,08	25,65	24,25	21,19	19,59	18,00

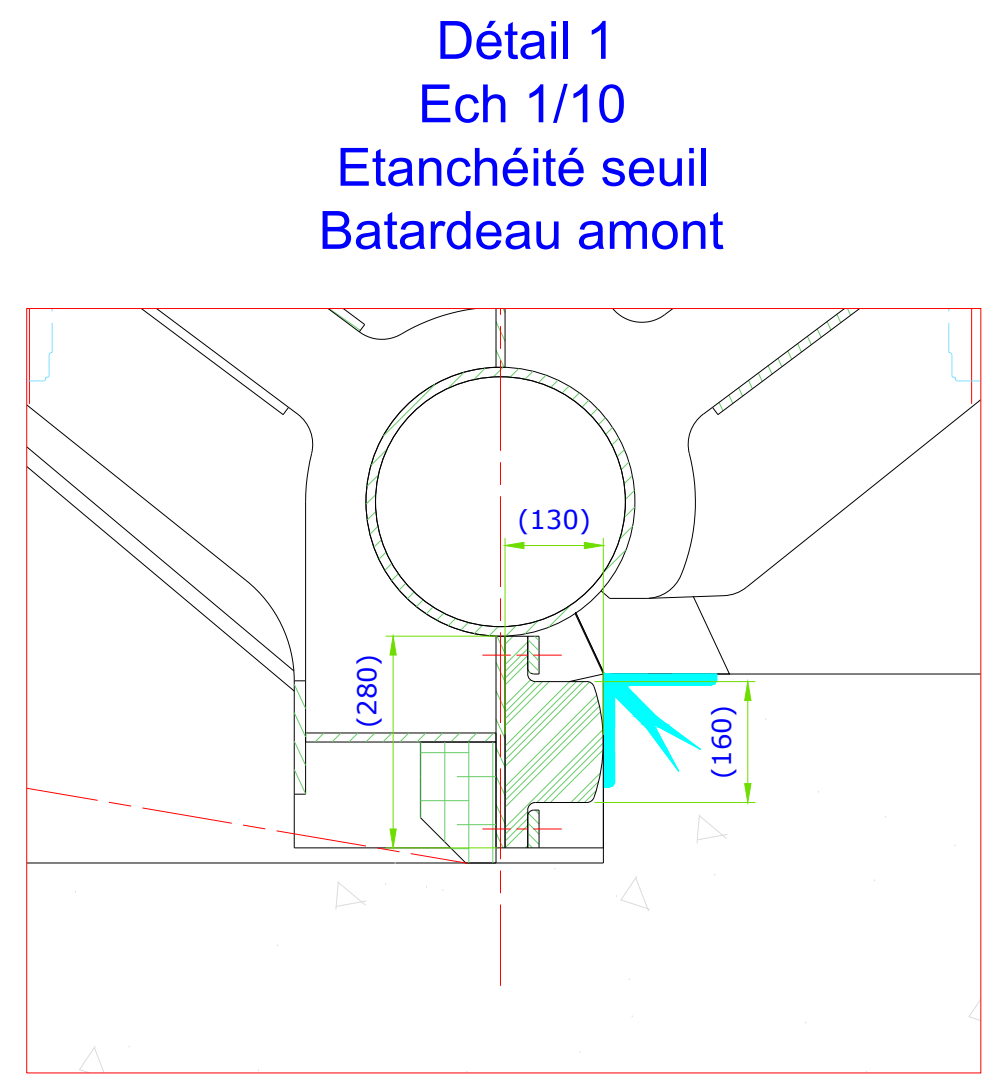

Valeurs extrêmes pour les barrages de Pontoise, Isle Adam, Boran, Sarron, Verberie et Venette		
Cotes en mm	min	max
C <sub>PH2C</sub> (pour info)	6 300	7 020
C <sub>PH2N</sub> (pour info)	5 620	6 000
C <sub>RN.amont exc.</sub>	4 430	4 430
C <sub>RN.amont moy.</sub>	4 030	4 180
C <sub>RN.amont nom.</sub>	3 930	3 930
C <sub>Q10</sub>	5 040	5 660
C <sub>Q5</sub>	5 450	6 000

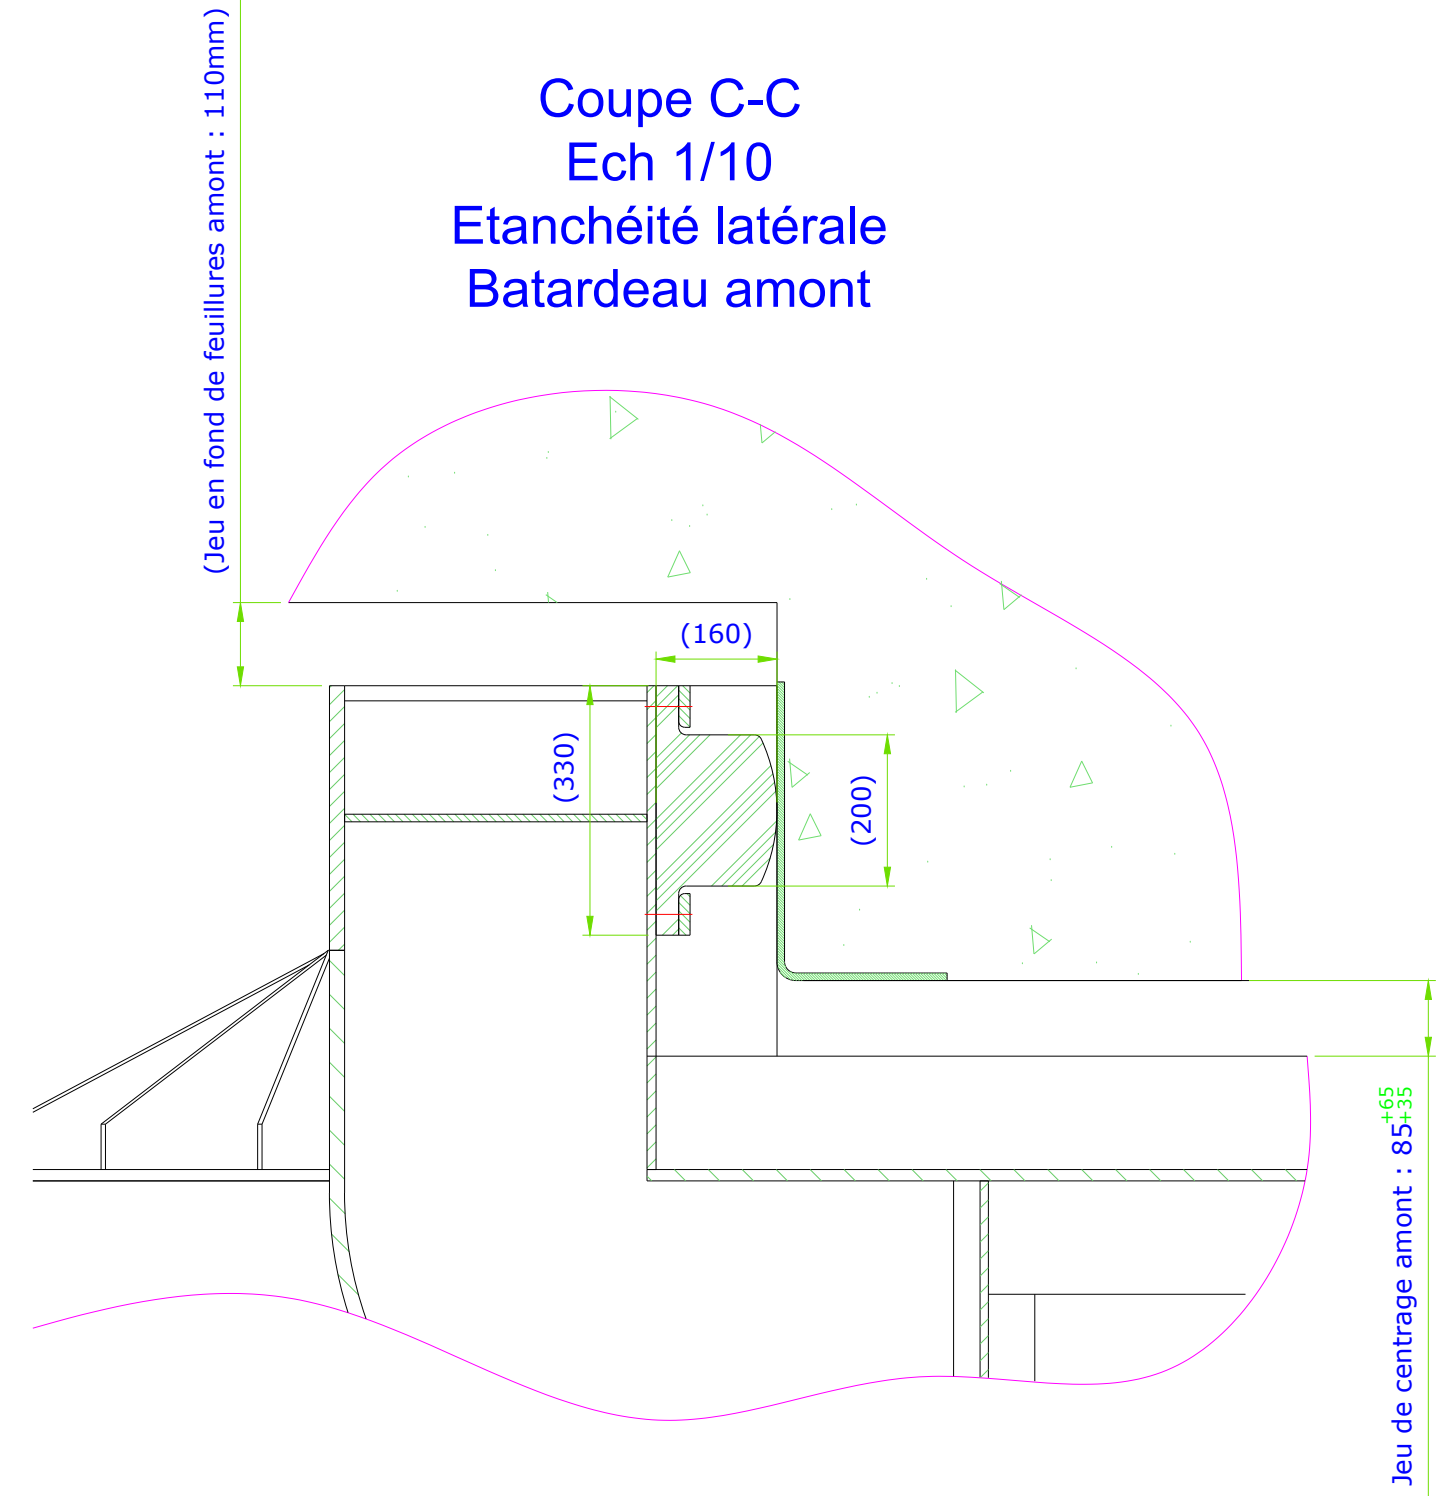

Localisation du barrage	Largeur passe 1 AMONT (mm)	Largeur passe 2 AMONT (mm)	Largeur passe 1 AVAL (mm)	Largeur passe 2 AVAL (mm)
Venette	31 036	30 953	32 496	32 507
Verberie	30 983	31 007	32 475	32 502
Sarron	31 017	30 962	32 492	32 502
Boran	33 003	33 005	34 483	34 489
Isle Adam	33 014	33 037	34 537	34 568
Pontoise	33 049	33 049	34 558	34 551