



- [C] Compteur électrique privé
- [H] Horloge
- [M] Minuterie
- [T] Télérupteur
- [V] Variateur
- [AU] Arrêt d'urgence

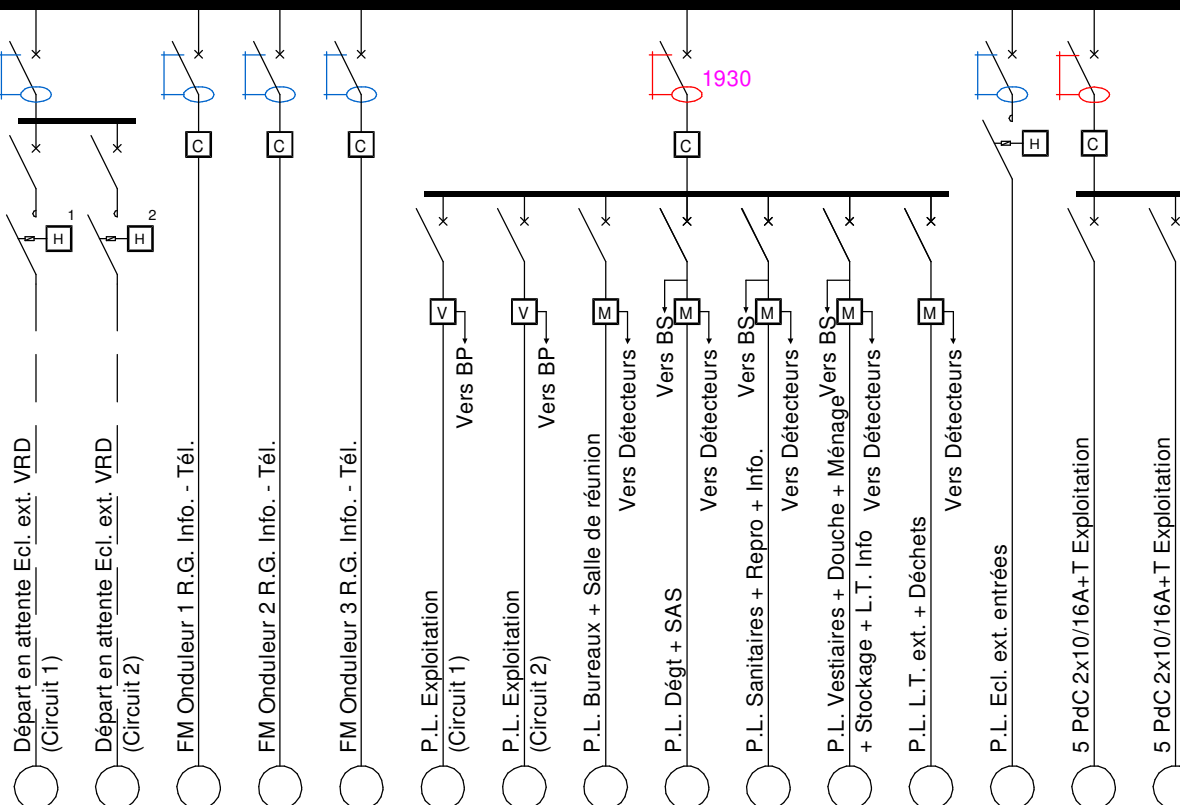


NOMBRE																						
PUISSANCE	W			5kVA	5kVA	5kVA	250	250	300	200	240	450	240		1500	1500						
CONTACTEUR	A	10	10											10								
TELERUPTEUR	A																					
MINUTERIE	A								10	10	10	10	10									
VARIATEUR	A						10	10														
INTERRUPTEUR	A																					
DISJONCTEUR	A	2x25		2x25	2x25	2x25				4x25				2x10	2x32							
RELAIS	A																					
SENSIBILITE	mA	300		300	300	300				30				300	30							
DISJ.DIV.BIPOLAIRE	A	10	10				10	10	10	10	10	10	10		16	16						
SECTION	mm <sup>2</sup>	-	-	3G4	3G4	3G4	3G1.5	3G1.5	3G1.5	3G1.5	3G1.5	3G1.5	3G1.5	3G1.5	3G2.5	3G2.5						

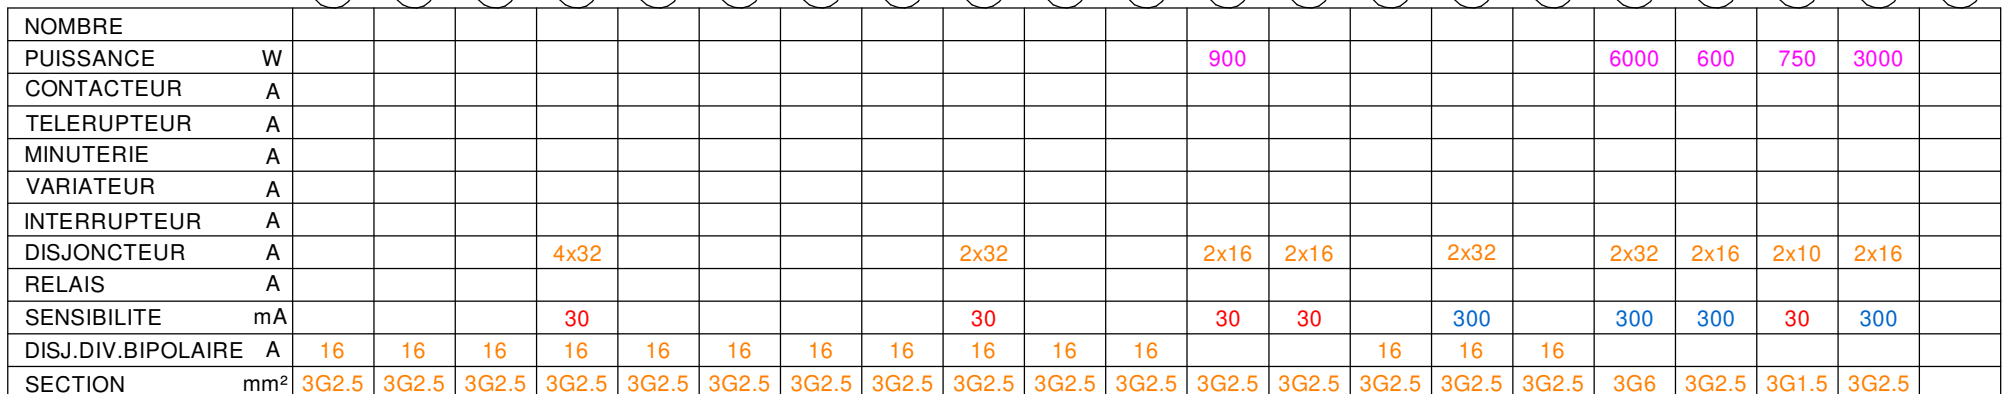


B

- C
- Compteur électrique  
privé
- H
- Horloge
- M
- Minuterie
- T
- Télérupteur
- V
- Variateur
- AU
- Arrêt d'urgence

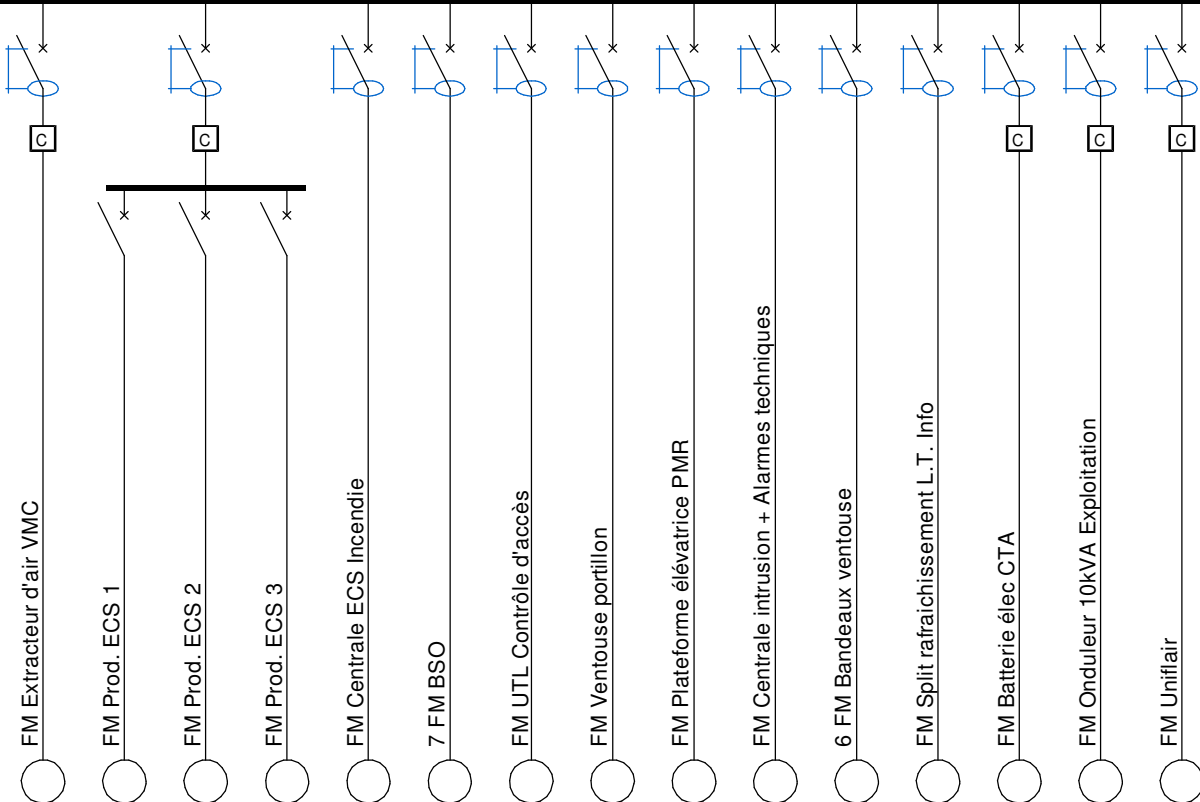


NOMBRE																				
PUISSANCE	W	100	2000	2000	3000								3000		5000					
CONTACTEUR	A																			
TELERUPTEUR	A																			
MINUTERIE	A																			
VARIATEUR	A																			
INTERRUPTEUR	A																			
DISJONCTEUR	A	2x10		4x32		2x16	2x16	2x16	2x16	4x16	2x16	2x16	2x16	2x16	4x25	4x16				
RELAIS	A																			
SENSIBILITE	mA	300		300		300	300	300	300	300	300	300	300	300	300	300				
DISJ.DIV.BIPOLAIRE	A		16	16	16															
SECTION	mm²	3G1.5	3G2.5	3G2.5	3G2.5	3G2.5	3G2.5	3G2.5	3G2.5	5G10	3G2.5	3G2.5	3G2.5	3G2.5	5G6	5G2.5				

A

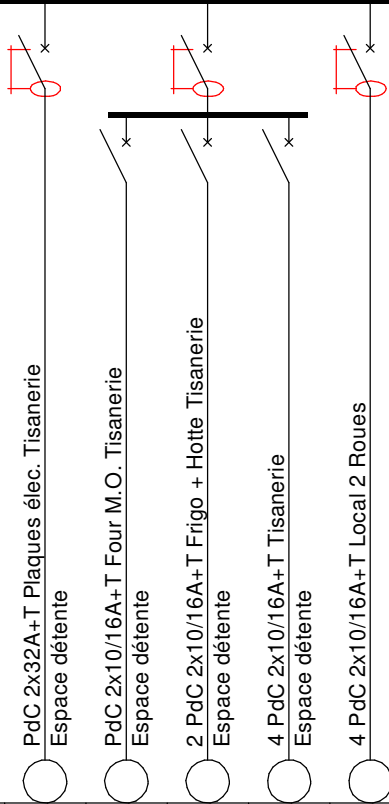[illegible]

A

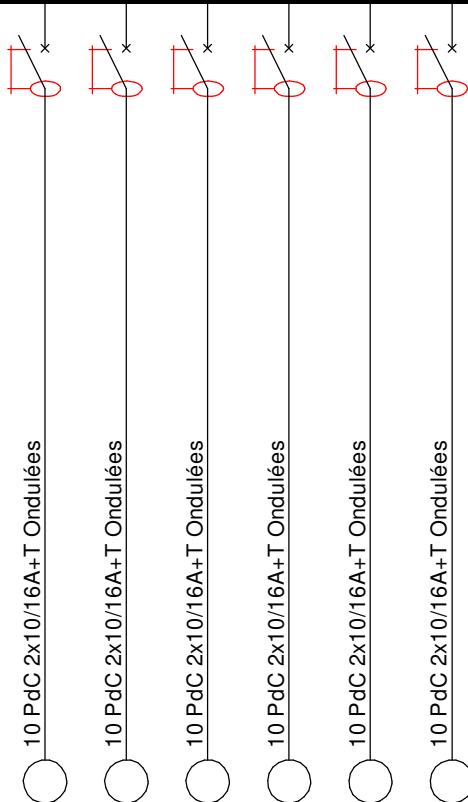[illegible]