

DATE:	OBSERVATIONS: DISK.44 C	INDICE
18/04/96	MISE A JOUR FOLIO 2	B
29/5/95	VENTILATEUR AIR NEUF	

LEROUX ET LOTZ
 NRH THALASSA IFREMER
 CLIMATISEUR
 LABO PROPRE
 ARMOIRE EF.4007

ET. J. PAUMIER & FILS



2.I. DE BABEUF
 76400 FECAMP


TEL. 35 10 23 50
 TELEX 190401 F
 TELECOPIE 35 29 34 78


ENTREE: LEROUX14

DATE: 06/2/95 CM

PLAN N

EL.420.18

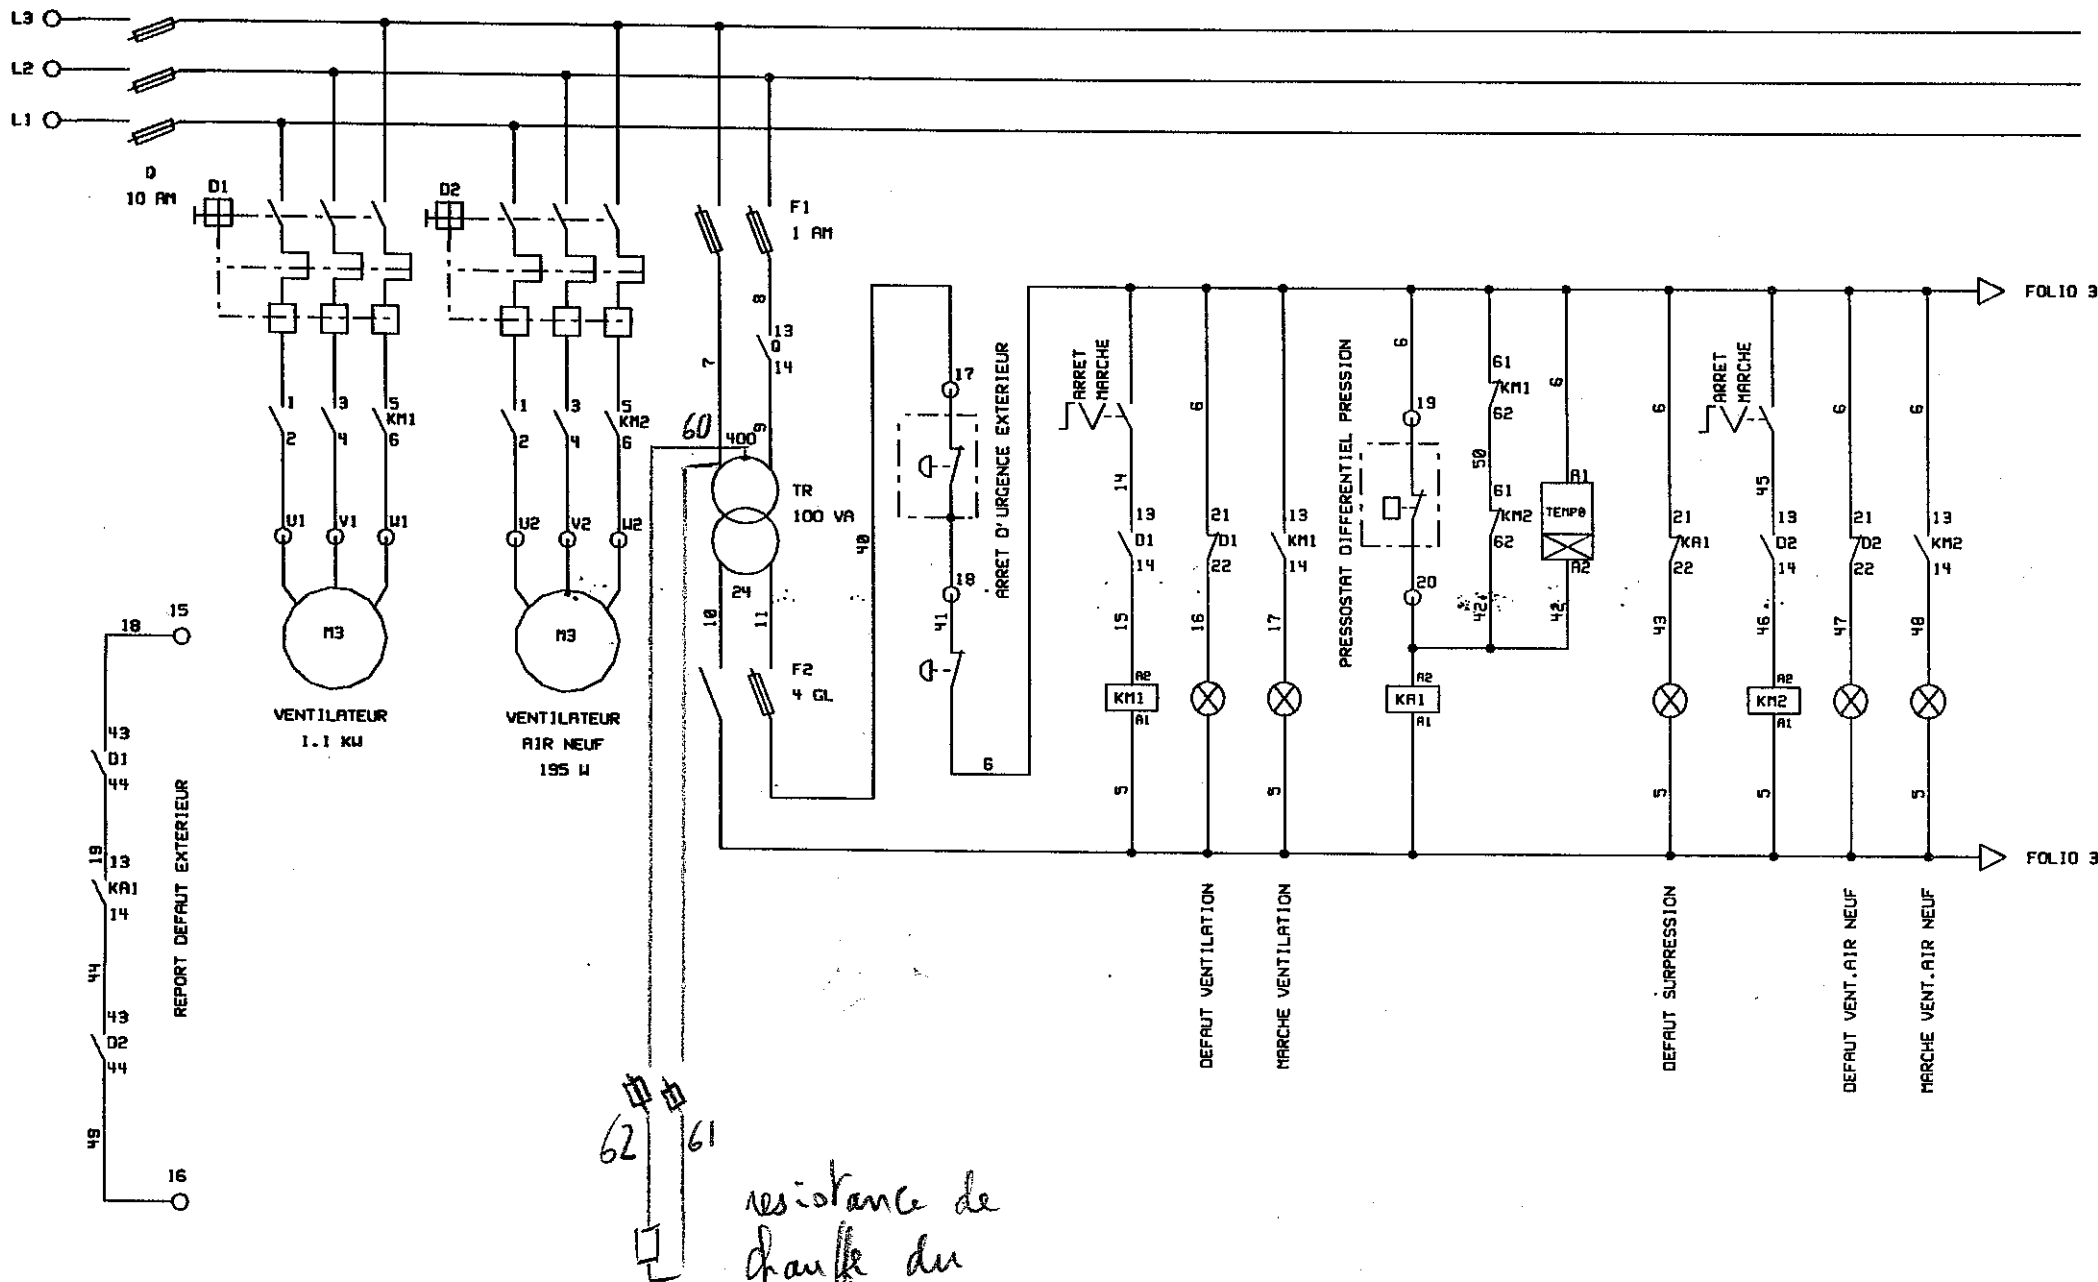

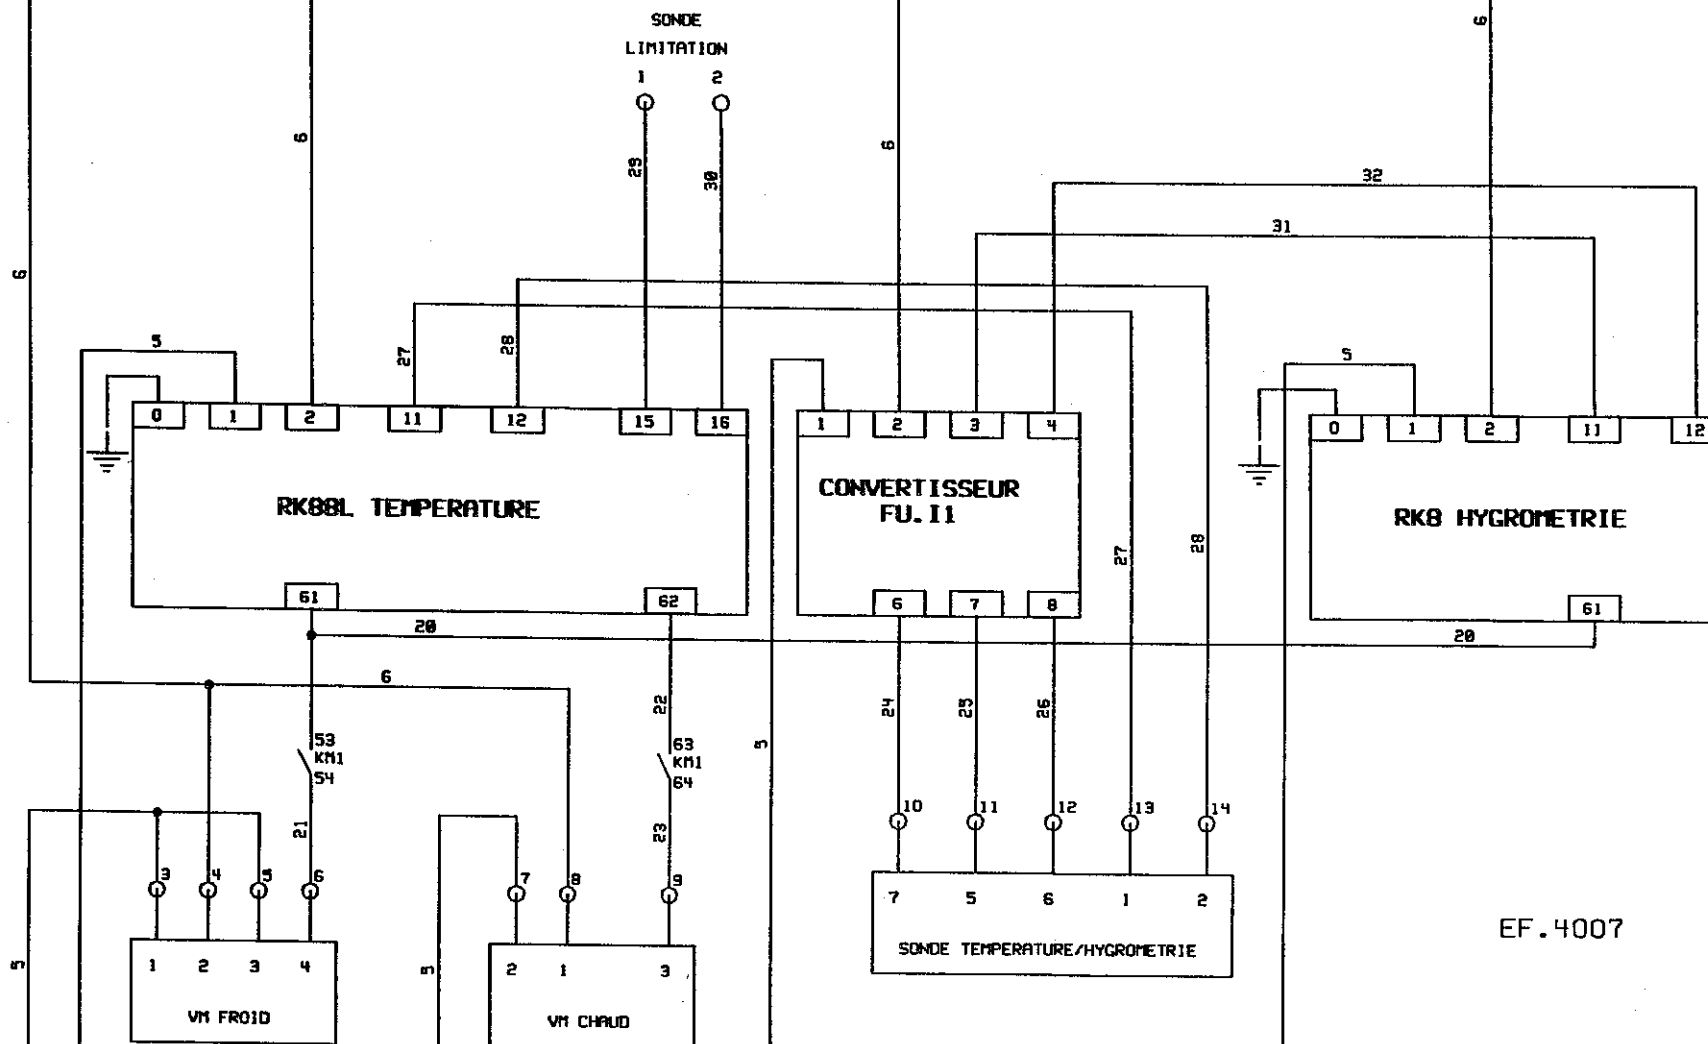

NRH THALASSA EF.4007

L1	L2	L3	U1	V1	U1	U2	V2	U2	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ALIMENTATION 400/3/50			VENTILATEUR 1.1 KW			VENTILATEUR AIR NEUF 195 W			SONDE LIMITATION TEMPERATURE		VM FROID			VM CHAUD			SONDE TEMPERATURE/HYGROMETRIE					REPORT DEFAUT EXTERIEUR		ARRET D'URGENCE EXTERIEUR		VERS EF44		PRESSOSTAT DIFFERENTIEL PRESSION	
									2	1	2	3	4	1	2	3	1	2	3	4	5	1	2	1	2	1	2		