
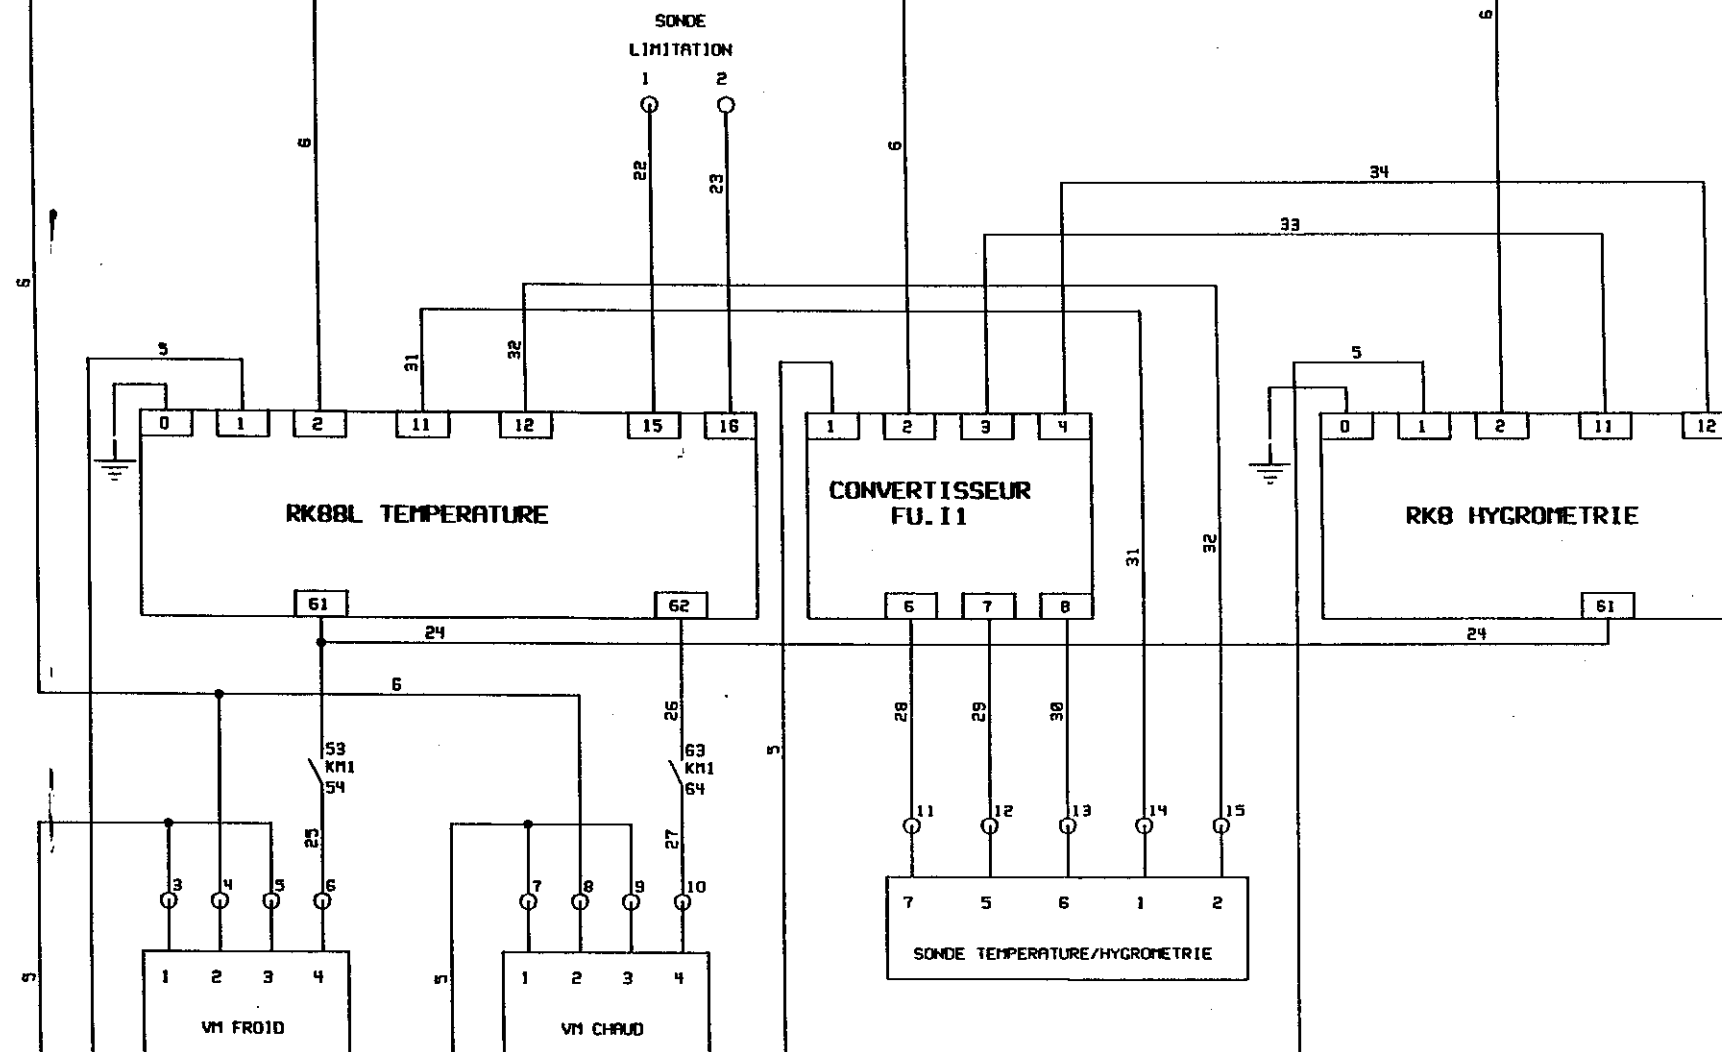


DATE:	OBSERVATIONS: DISK.44 C		
13/03/95	MIS A JOUR ARRET D'URGENCE		
LEROUX ET LOTZ NRH THALASSA IFREMER CLIMATISATION TIMONERIE ARMOIRE EF.4311		ET. J. PRUMIER & FILS  Z.I. DE BABEUF 76400 FECAMP TEL. 35 18 23 58 TELEX 190401 F TELECOPIE 35 29 34 78	
		ENTREE: LEROUX18	DATE: 08/2/95 CH
		PLAN N	EL.420.22



EF.4311

NRH THALASSA EF.4311

L1	L2	L3	U1	V1	U1	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	
								1	2	3	4	1	2	3	4	1	2	3	4	5	1	2	3	4	
ALIMENTATION 400/3/50						VENTILATEUR 1.03 KW						SONDE LIMITATION TEMPERATURE						SONDE TEMPERATURE/HYGROMETRIE						REPORT DEFRAUT + ARRET D'URGENCE	
																								VERS COFFRET EF.4310	