




699 110 75

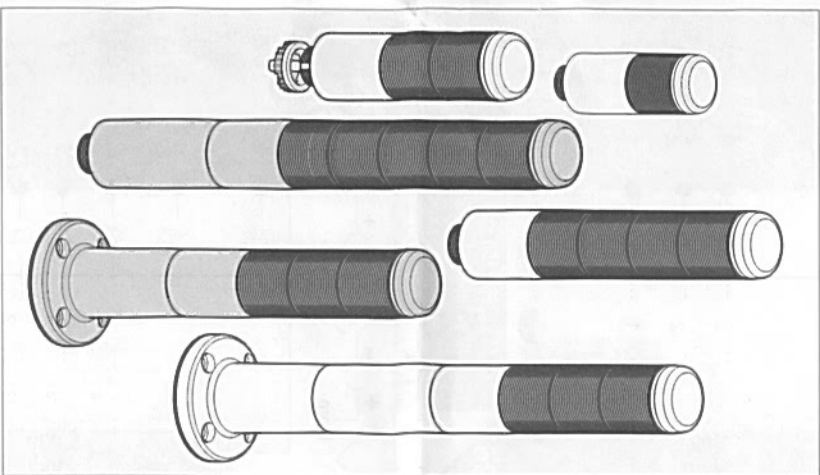


- D** Anschluss **ausschließlich** durch ausgebildete Elektro-Fachkräfte.
- GB** Electrical connection is to be made by trained electrical specialists **only**.
- F** Le branchement doit **uniquement** être effectué par des professionnels.
- I** Il collegamento deve essere eseguito **solo** da elettricisti specializzati.
- E** La conexi3n **s3lo** debe ser realizada por electricistas debidamente formados.
- PT** A ligac33o deve ser feita **exclusivamente** por profissional el3ctrico especializado.
- NL** De aansluiting mag **enkel** gebeuren door erkende vakmensen.
- CZ** P3ipojení sm3 **provád3t** pouze kvalifikov3n3 person3l.
- PL** Podci3czenie wyl3cznicze przez specjalist3w-elektryk3w.
- FI** Liitt3minen kuuluu **ainoastaan** koulutettujen s3hk33d3alan ammattil3isten teht3viin.
- RU** Подключен3е проводитс3 только специ3-лист3м-электриком.
- TR** Bağılantı **sadece** eđitilmiş elektrik teknisyenleri tarafından yapılmalıdır.
- CN** 布线需由专业电工执行

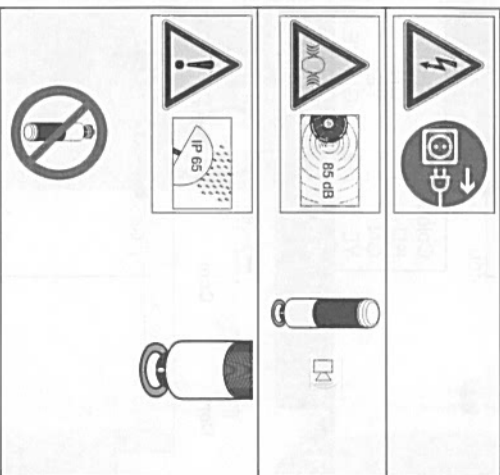

699 X10 75	24 V \approx , I $_{max}$ < 100 mA
699 X30 75	< 2 x 50 mA
698 901 74	12 V \approx , I $_{max}$ < 50 mA
698 X70 75	24 V \approx , I $_{max}$ < 50 mA
699 X70 75	24 V \approx , I $_{max}$ < 100 mA
698 X20 75	24 V \approx , I $_{max}$ < 100 mA
698 X30 75	< 2 x 50 mA
698 X20 74	12 V \approx , I $_0$ < 250 mA
698 X30 74	< 2 x 125 mA
699 X20 75	24 V \approx , I $_0$ < 150 mA
699 X30 75	< 3 x 50 mA
699 X20 74	12 V \approx , I $_0$ < 350 mA
699 X30 74	< 2 x 125 mA + < 1 x 100 mA
698 X10 75	24 V \approx , I $_0$ < 150 mA
698 X10 74	12 V \approx , I $_0$ < 360 mA
699 X10 75	24 V \approx , I $_0$ < 200 mA
699 X10 74	12 V \approx , I $_0$ < 460 mA
698 X40 75	< 3 x 120 mA + < 1 x 100 mA
698 X50 75	24 V \approx , I $_0$ < 200 mA
699 X40 75	24 V \approx , I $_0$ < 250 mA
699 X50 75	< 5 x 50 mA
698 X60 75	24 V \approx , I $_0$ < 250 mA
699 X60 75	< 5 x 50 mA
699 X60 75	24 V \approx , I $_0$ < 300 mA
699 X60 75	< 6 x 50 mA

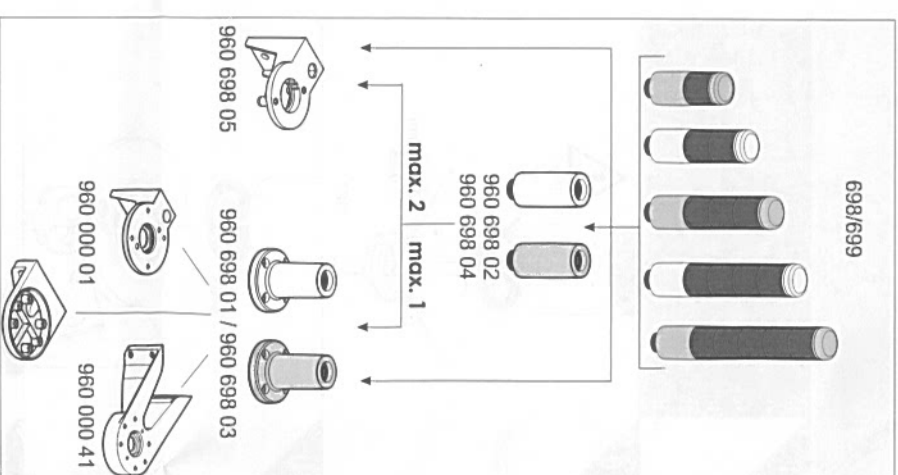

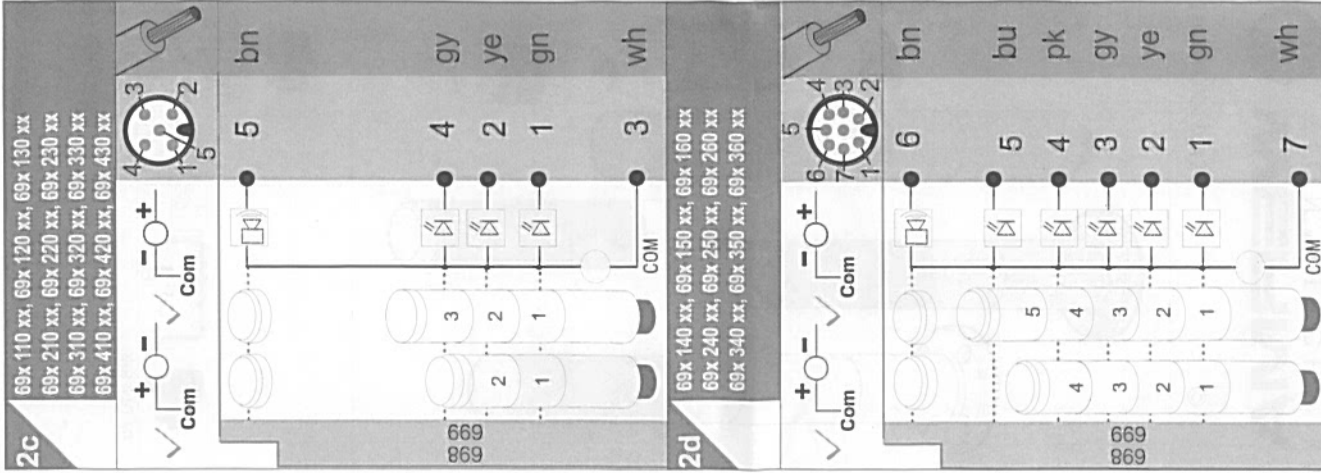

310.698.001.0815

© D



WERMA
SIGNALTECHNIK

