


PROJET DE RESTAURATION, ET DE RÉHABILITATION
DU CASINO DE HAMMAM-LIF

ARMOIRE ELECTRIQUE
DP-100

DATE :
FEVRIER 2025

FOLIO : 02

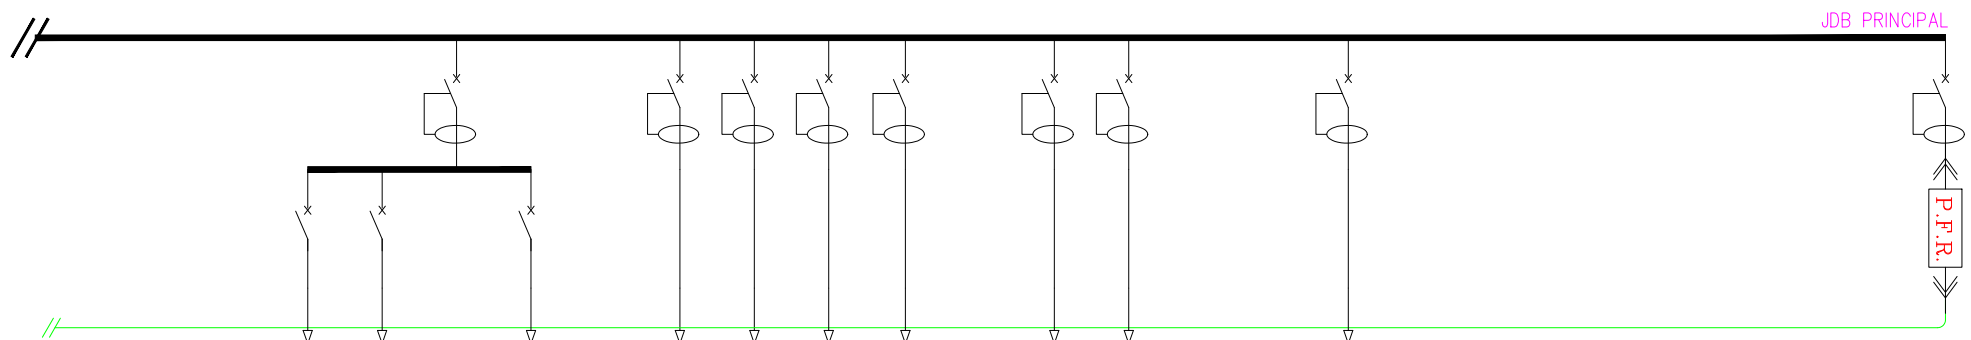

DEPART N°	16	17	DG04	R		18	19	19	20		R	R			21						22
PUISSANCE (W)	1600	1400	----	----		500	500	500	250		----	----			283						----
SECTION CÂBLE (mm²)	3x2.5°	3x2.5°	4x4°	----		CR1 3x2.5°	CR1 3x2.5°	3x2.5°	3x2.5°		----	----			4x50°						1x35°
LONGUEUR CÂBLE (m)	----	----	----	----		----	----	----	----		----	----			----						----
PROTECTION (A)	2X16	2X16	4X25	2X16		2X16	2X16	2X16	2X16		2X25	2X25			4X125						4X25
Nbr DES POLES	2P1d	2P1d	4P4d	2P1d		2P2d	2P2d	2P2d	2P2d		2P2d	2P2d			4P4d						4P4d
COURBE DE DECLENCHEMENT	C	C	C	C		C	C	C	C		C	C			D						C
RELAIS (mA)	----	----	30	----		300	300	300	300		300	300			DDR REG T&S						300
TYPE RELAIS	----	----	A	----		A	A	A	A		A	A			A						S
AFFECTATION	DEPART PRISE COURANT CIRCULATION	DEPART PRISE COURANT ACCUEIL/LT	DEPART GENERALE PRISE COURANT	DEPART PRISE COURANT RESERVE		DEPART CENTRALE DETECTION INCENDIE	DEPART CARTE ASSERMISMENT	DEPART CENTRALE DETECTION INTRUSION	DEPART TABLEAU DE COMANDE		DEPART RESERVE	DEPART RESERVE			DEPART DP-101						DEPART PARAFODRE TYPE I-2 Imax=25KA