

DSI

Switch DSI

BACnet IP

Coffret GTC

LOT
CVC /
REGULATION

Régulateur terminal RP-C

Alimentation

Automate
Server

Module 16
E UNI

Module 12
STOR

Module 8
SANA

IHM local
(Advanced Display)

Armoire GTC – Local Technique

NIV
3

NIV
2

NIV
1



DSI

Switch DSI

NIV
3

BACnet IP

Coffret GTC

LOT
CVC /
REGULATION

Unité centrale

Module 16
ETOR

Module 8 E/S
UNI

Module 6
STOR

NIV
2

IHM local
(PXM40.E)

Armoire GTC – Local Technique

Régulateur terminal PXC3



NIV
1

DSI

Switch DSI

BACnet IP

NIV
3

LOT
CVC /
REGULATION

Unité centrale

Module 16
ETOR

Module 8 STOR

Module 8 E/S
UNI

IHM local (IQ VIEW)

Armoire GTC – Local Technique

NIV
2

NIV
1




DSI

Switch DSI

BACnet IP

NIV
3

LOT
CVC /
REGULATION

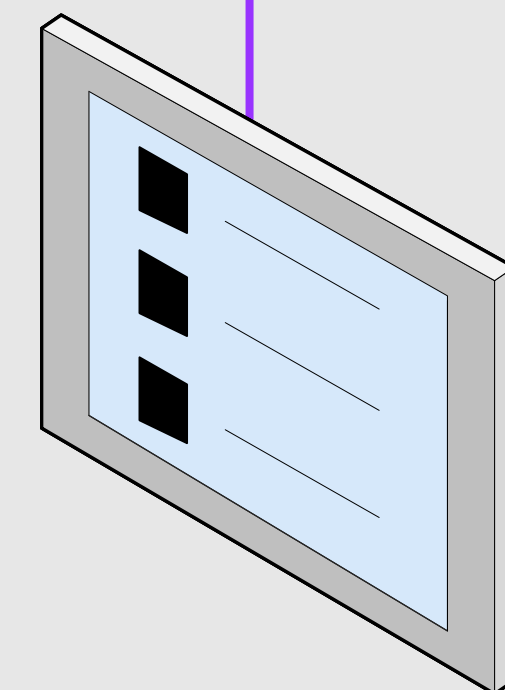

IHM local (TACTILEXXXW10)

Armoire GTC – Local Technique

Unité centrale

Module 16
ETOR

Module 8
EANA + 8 UNI

Module 6
STOR

Module 8
EANA + 8
SANA

NIV
2



NIV
1