


The diagram illustrates a ventilation system layout. At the top, a horizontal duct is labeled 'R+9' and 'Ventilateur'. Below it, two more horizontal ducts are shown, each labeled 'Ventilateur'. These ducts are connected to a central 'Commande et Bus' unit. The unit has three outputs, each labeled 'Passage en faux-plafond et dans les cloisons existantes (compris dépose/repose des plaques et mise en place de nouvelles gaines ICTA/IRL)'. The unit also has a 'Ventilateur' label at its inlet. The entire system is enclosed in a blue border.

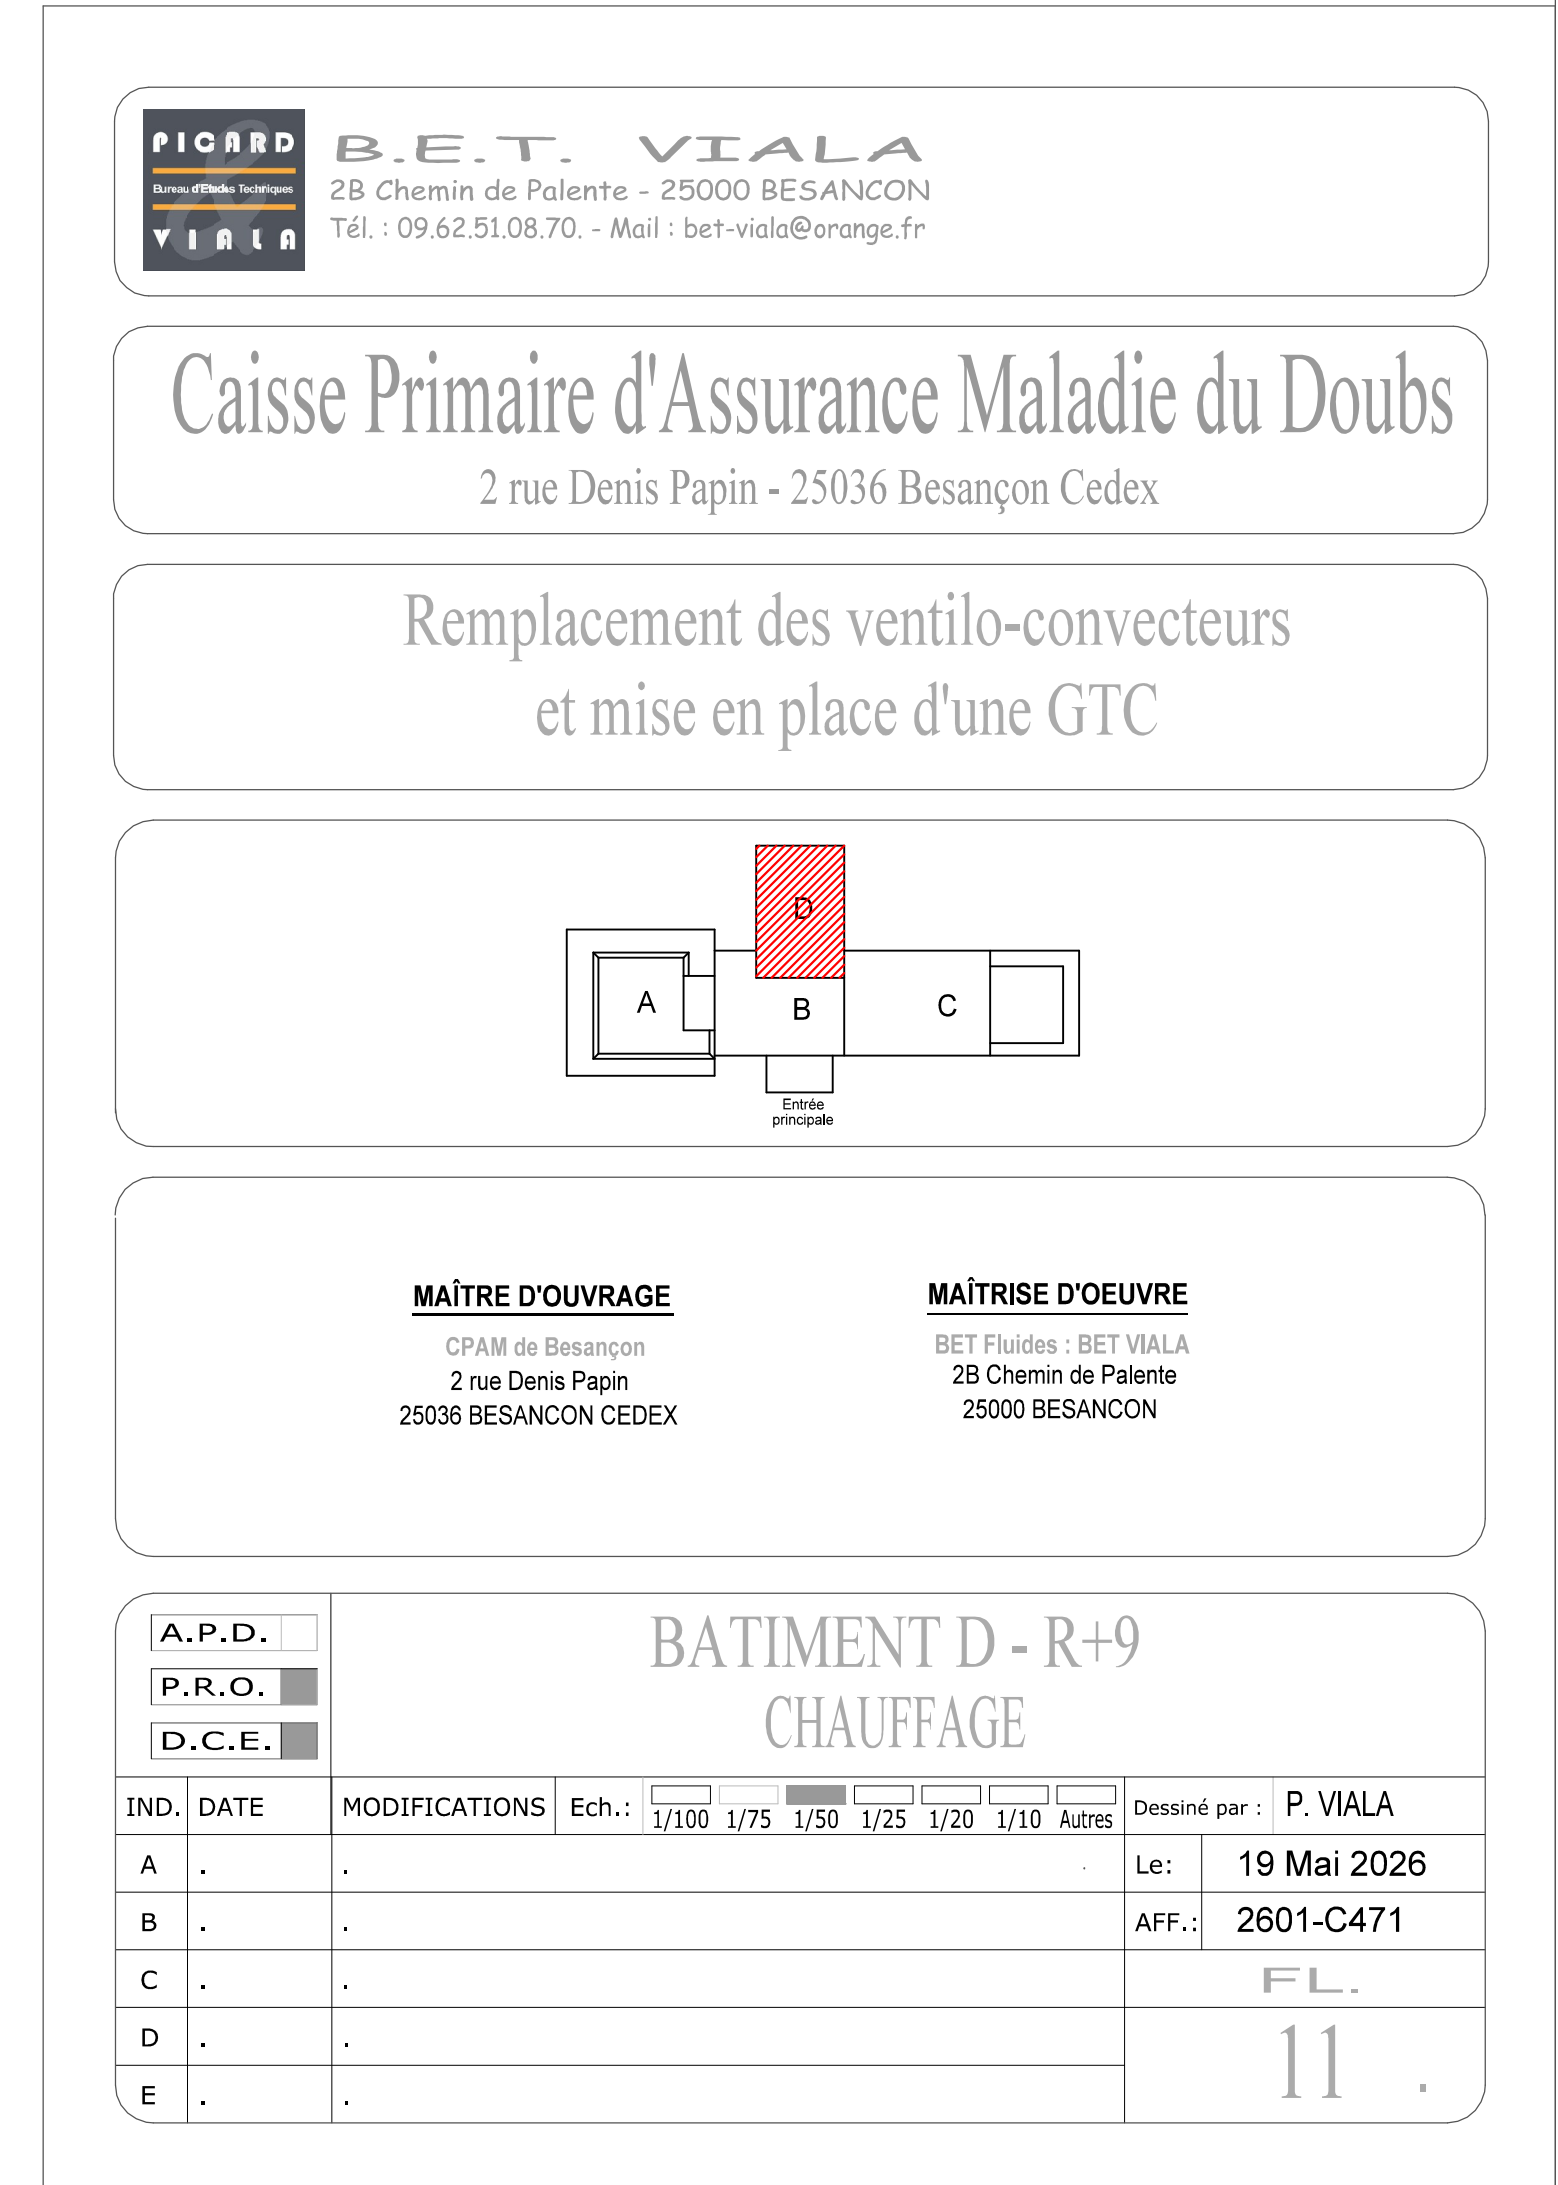

<u>MAÎTRE D'OUVRAGE</u> CPAM de Besançon 2 rue Denis Papin 25036 BESANCON CEDEX	<u>MAÎTRISE D'OEUVRE</u> BET Fluides : BET VIALA 2B Chemin de Palente 25000 BESANCON
--	---

A.P.D. ☐		BATIMENT D - R+9 CHAUFFAGE										
P.R.O. ☐												
D.C.E. ☐												
IND.	DATE	MODIFICATIONS	Ech.:	☐ 1/100	☐ 1/75	☒ 1/50	☐ 1/25	☐ 1/20	☐ 1/10	☐ Autres	Dessiné par : P. VIALA	
A	.	.									Le:	19 Mai 2026
B	.	.									AFF.:	2601-C471
C	.	.									FL.	
D	.	.									11.	
E	.	.										