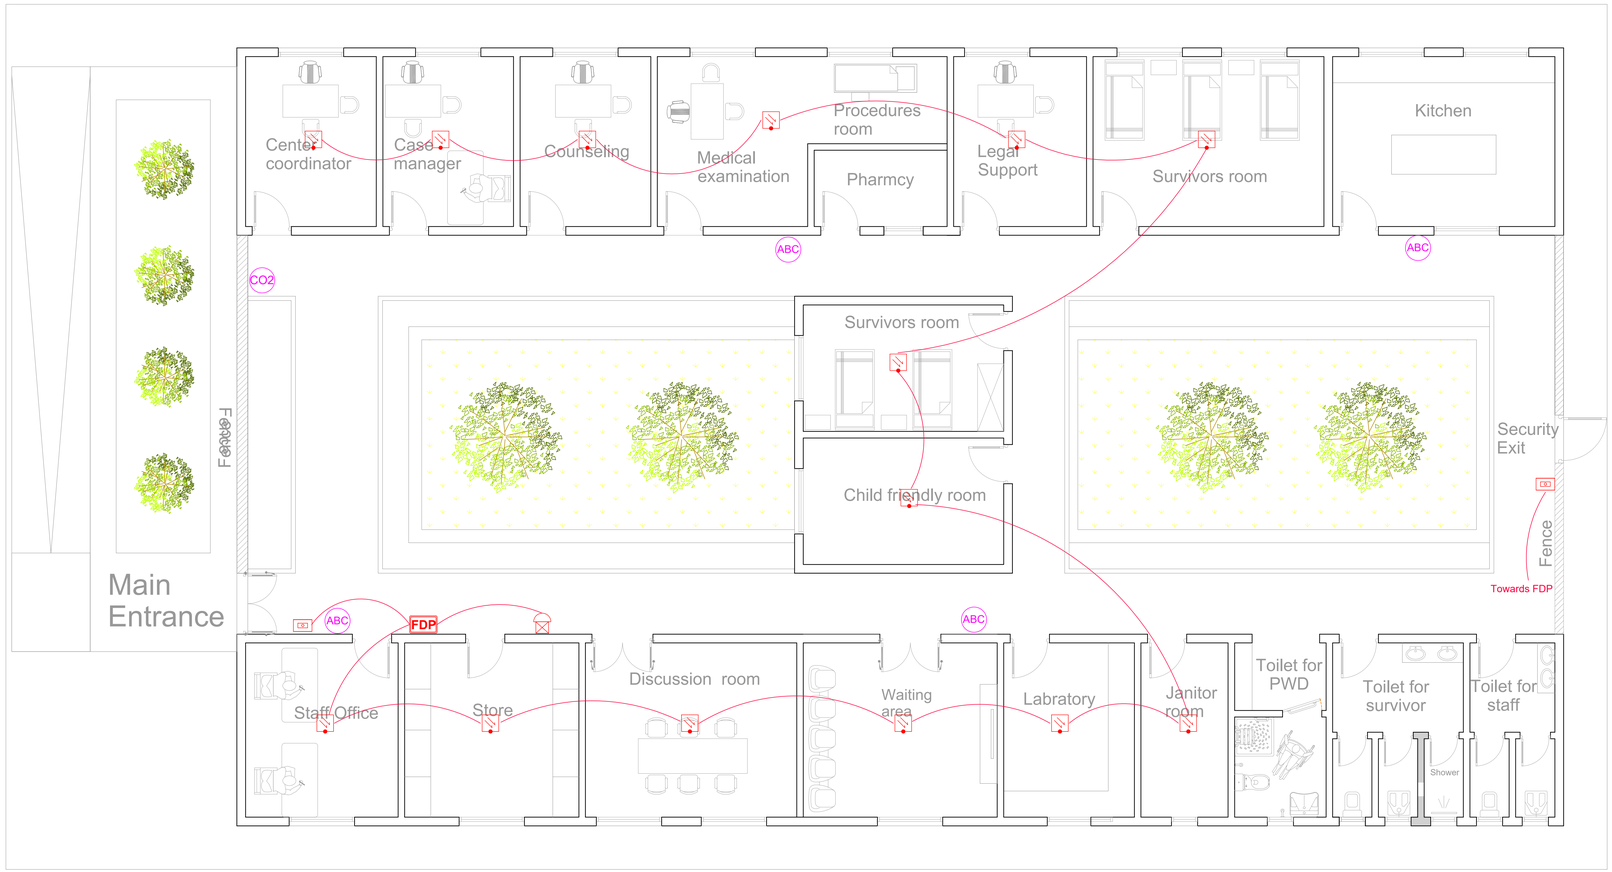


## LEGEND

| SYMBOLE | DESIGNATION |
|---|---|
| | Smoke detector |
| | Manual call point |
| FDP | Fire Detection Panel |
| | Sounder |
| CO2 | CO2 Fire Extinguisher - 5Kg |
| ABC | Multipurpose Powder Fire Extinguisher - 6Kg |

| | | |
|---|---|---|
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| D | 01/07/2026 | Revision |
| B | 26/06/2026 | Final |
| A | 11/05/2026 | First draft |
| Index | Date | Description |

Tableau des révisions

| Designed by : | Naceur SHILI | Checked by : | Nejib KRID | Approved by : | Ministry of Health |
|---|---|---|---|---|---|

FEDERAL DEMOCRATIC REPUBLIC OF ETHIOPIA

PROJECT:

ADWA AND ABALA HOSPITALS REHABILITATION PROJECTS

**Project Owner** **Ministry of Health MoH**

**Delegated Project Owner**

**EXPERTISE FRANCE SAS**

Adress:
40, BOULEVARD DE PORT ROYAL - 75005 PARIS, FRANCE

**Master of Works**

**Joint venture : MOSAÏQUE INGENIEURIE FRANCE & MTT**

Adress:
Le HUB - Business Center 6, rue du Bois Sauvage 91000
(+33) 618 48 02 11/(+33) 1 84 18 14 79/(+33) 1 84 18 14 80
E-mail : Contact@mosaique-ingenierie-france.com
website : www.mosaique-ingenerie.com

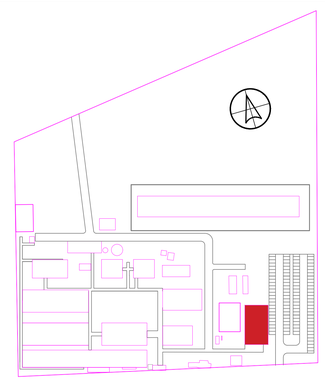

Source of Standard OSC Design : Ministry of Health MoH

SITE/BLOC: ABALA HOSPITAL - ONE STOP CENTER

SCALE 1:100

PLAN TITLE : FIRE DETECTION

TIME OF CREATION: 11-5-2026

| MOS | 25126 | ABL | DCE | ELE | 02 | 03 | 23 | 01 | 01 | B |
|---|---|---|---|---|---|---|---|---|---|---|
| ISSUER | CODE | SITE | PHASE | DISCIPLINES | SITE | DISC | BLOC | LVL | BN | INDEX |